
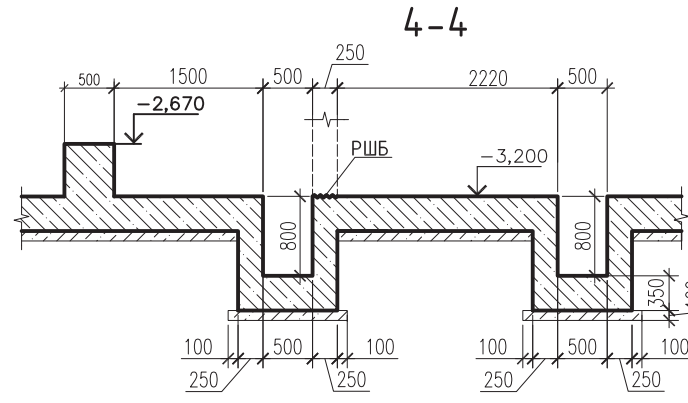
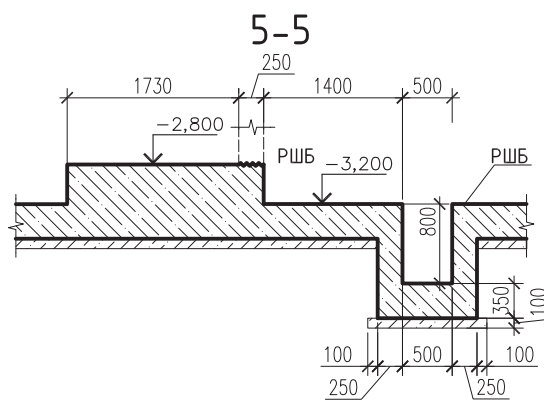
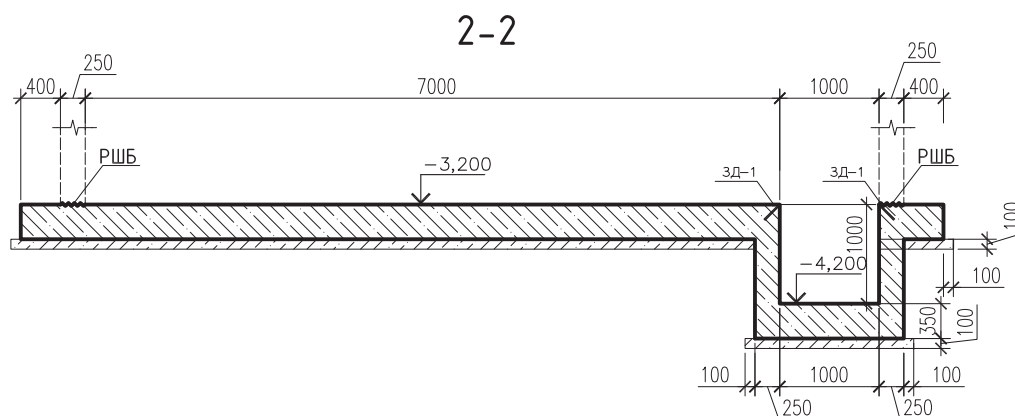
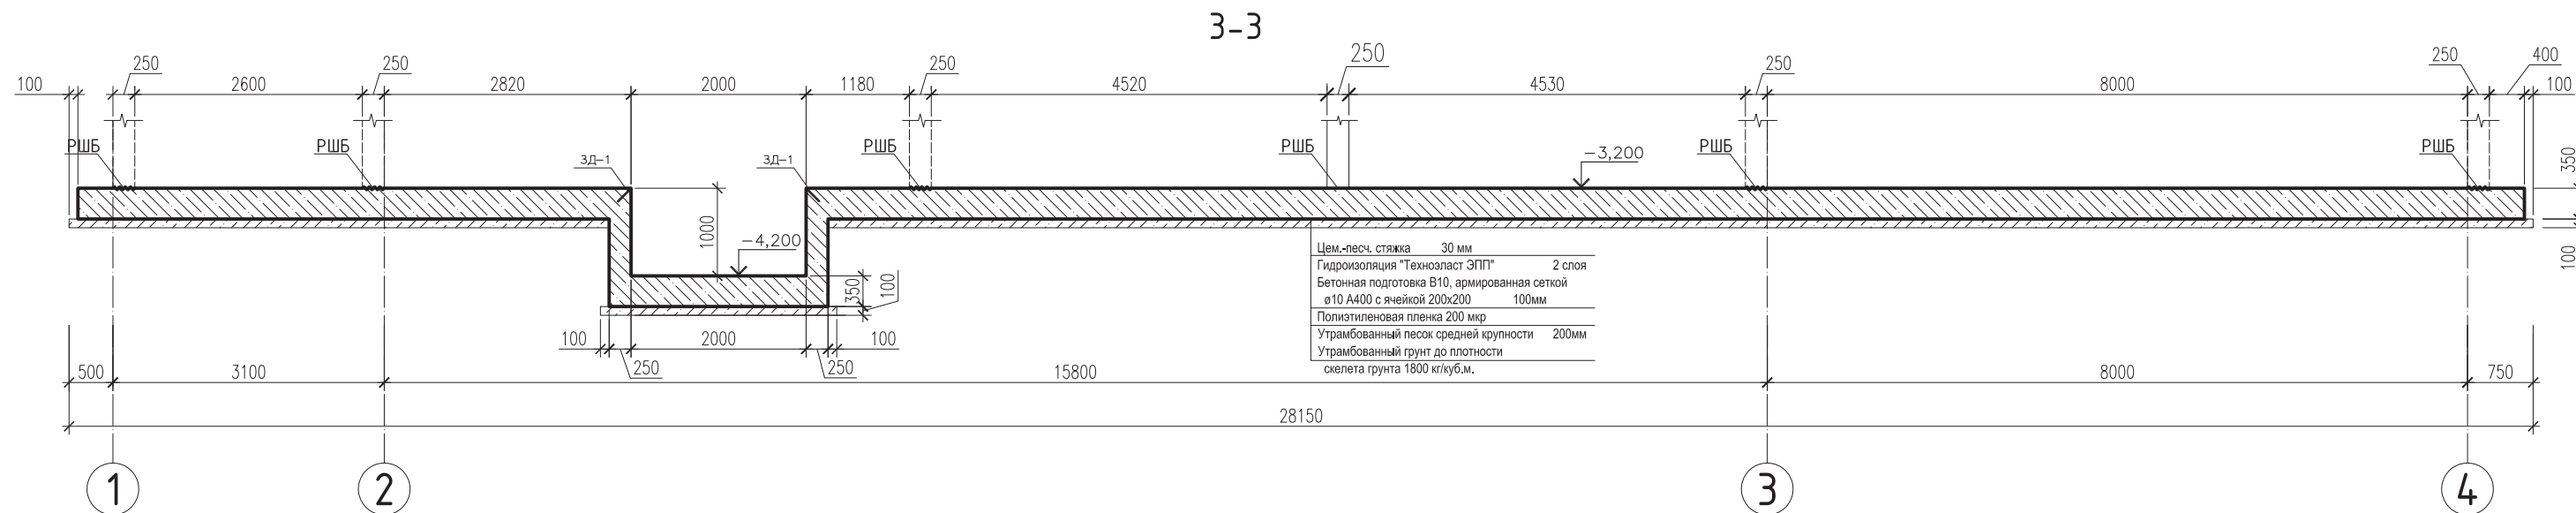
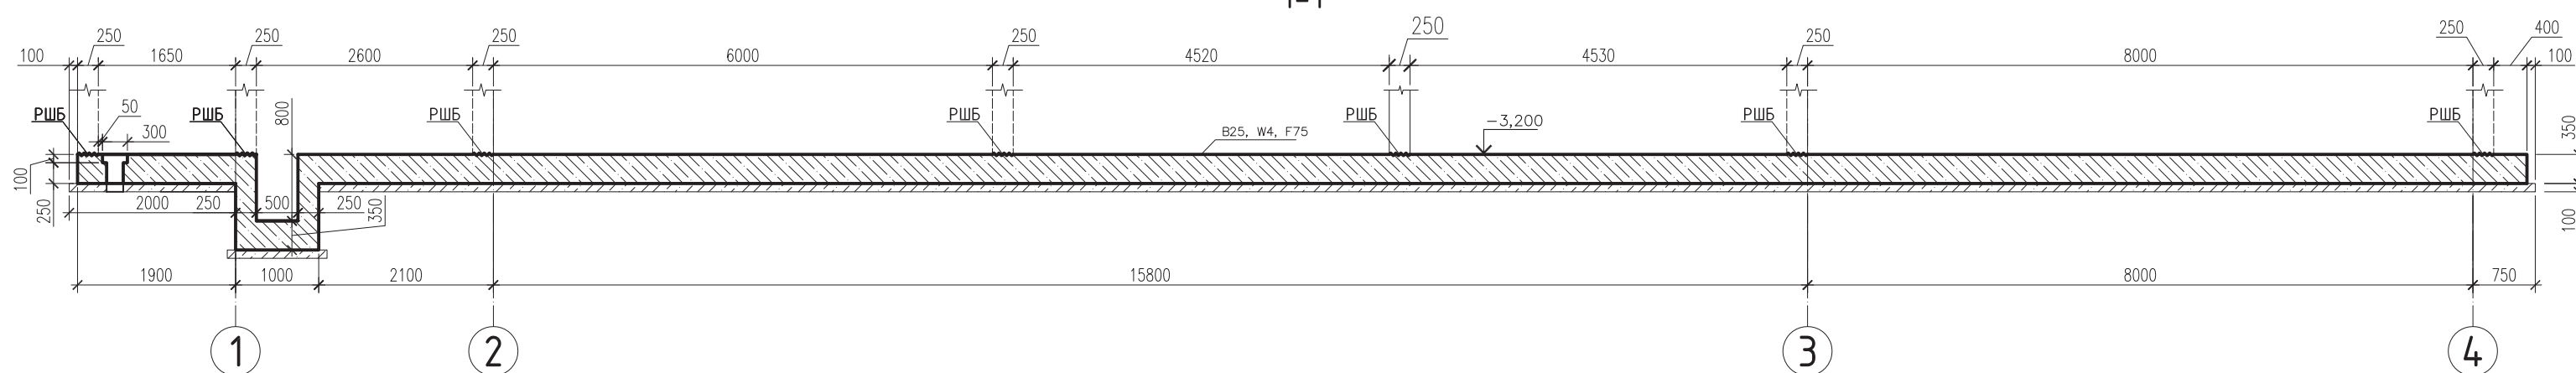
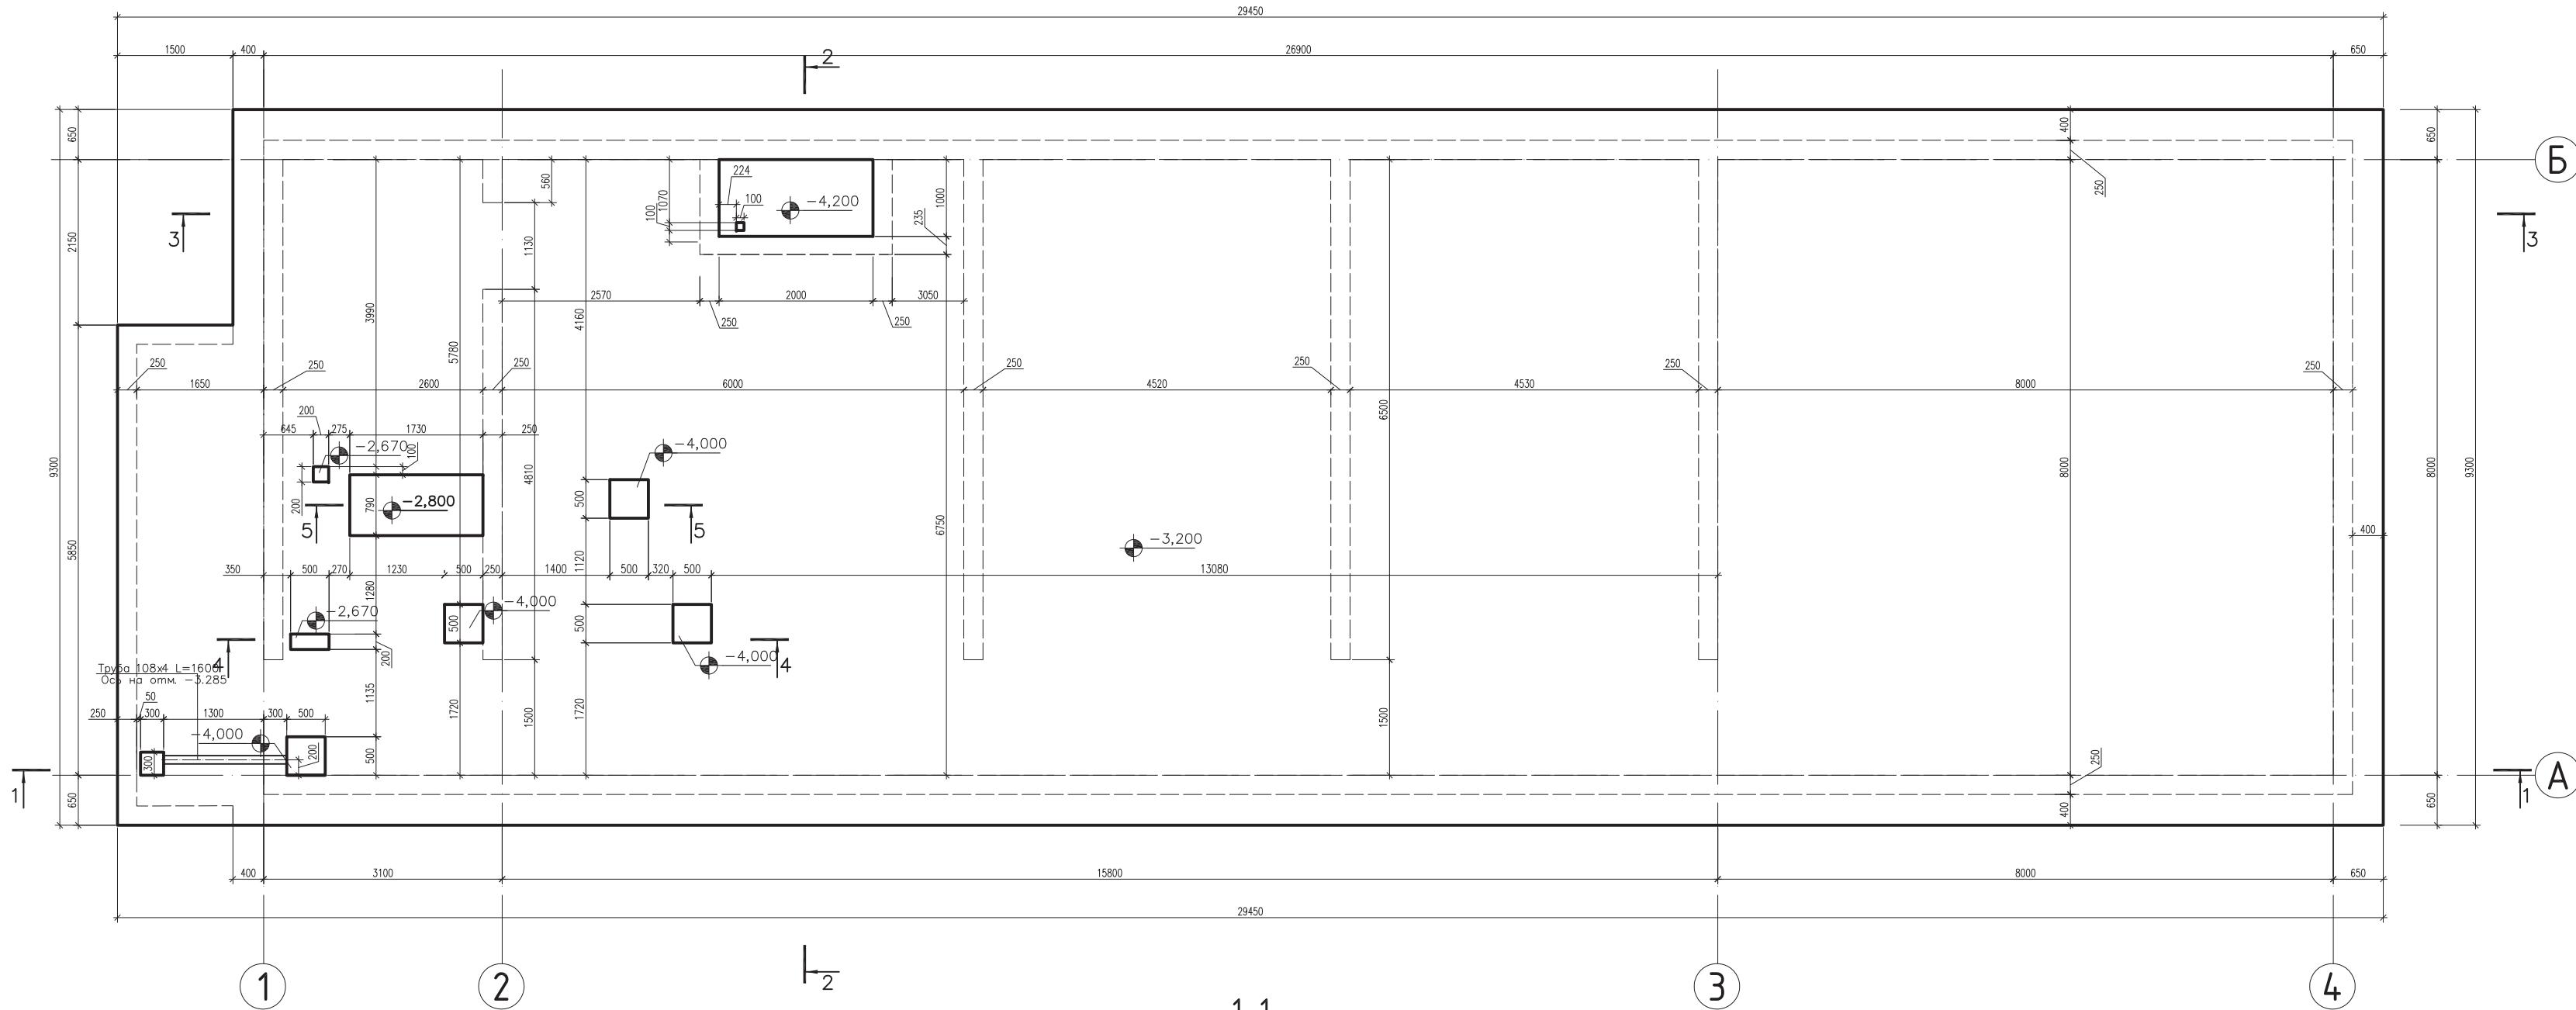


Опалубочный план фундаментной плиты на отметке -3.200



Спецификация					
Поз.	Обозначение	Наименование	Кол.	Масса ед., кг	Приме- чание
		A400C Ø10 по месту L=3750	1	2313,75	
1		A500C Ø14 L=11700	178	14,16	
2		A500C Ø14 L=8550	12	10,35	
3		A500C Ø14 L=7570	66	9,16	
4		A500C Ø14 L=6140	28	7,43	
5		A500C Ø14 L=9220	260	11,16	
6		A500C Ø14 L=7220	20	8,74	
7		A500C Ø14 L=6420	14	7,77	
8		A500C Ø12 L=6400	6	5,68	
9		A240C Ø8 L=1200	331	0,47	
10		A500C Ø14 L=3220	65	3,90	
11		A500C Ø14 L=1900	13	2,30	
12		A500C Ø14 L=3100	20	3,75	
13		A500C Ø14 L=4100	13	4,96	
14		A500C Ø14 L=5550	8	6,72	
15		A500C Ø12 L=2438	509	2,16	
16		A500C Ø14 L=4462	8	5,40	
17		A500C Ø14 L=4645	8	5,62	
18		A240C Ø8 L=1510	5	0,60	
19		A240C Ø8 L=1850	9	0,73	
20		A240C Ø8 L=1690	6	0,67	
21		A500C Ø14 L=2750	20	3,33	
22		A500C Ø14 L=2640	41	3,19	
23		A500C Ø14 L=2550	20	3,09	
24		A500C Ø14 L=4400	11	5,24	
25		A500C Ø14 L=4070	8	4,92	
26		A500C Ø14 L=2890	8	3,50	
46		A240C Ø8 L=960	275	0,38	
111		L 75x75x6 – 6000	1	41,33	
112		A240C Ø8 L=200	30	0,08	
113		○ 108x4 L=1600	1	16,42	
		Материалы			
		Бетон B25, W4, F75	99м³		
		Бетон B10	30м³		

- 1) Длина перехлеста арматуры для $\Phi 14$ равна 800 мм
- 2) Не допускается стык более 50% стержней в 1 сечении

[illegible]